




ARQUETA PARA LLAVE DE PASO O VENTOSA
EN TUBERIAS DE ø80 A 150 mm.

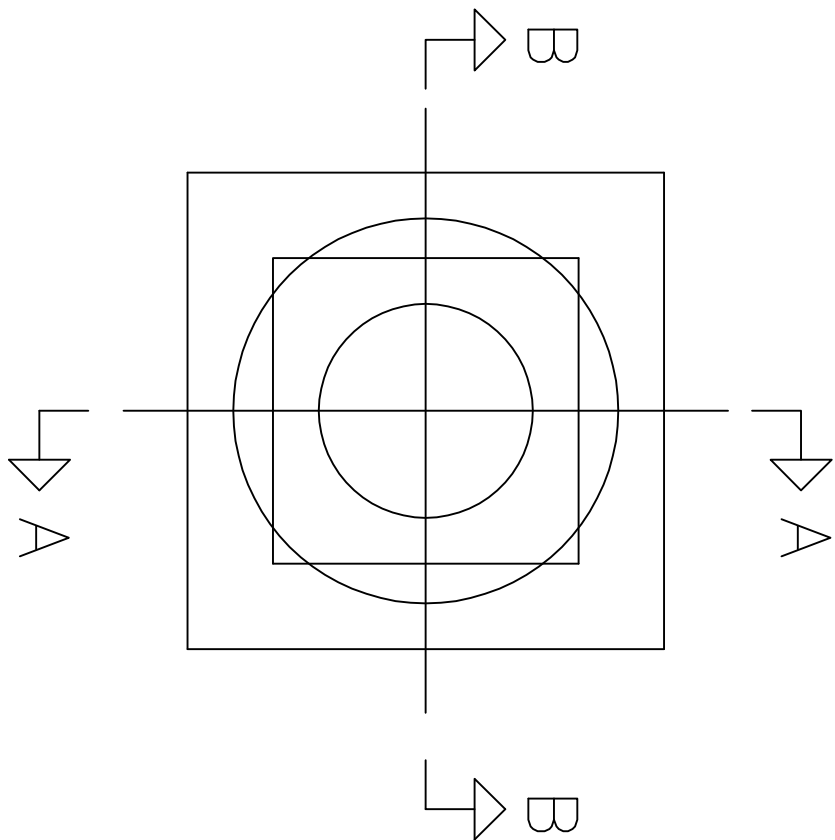


PLANTA

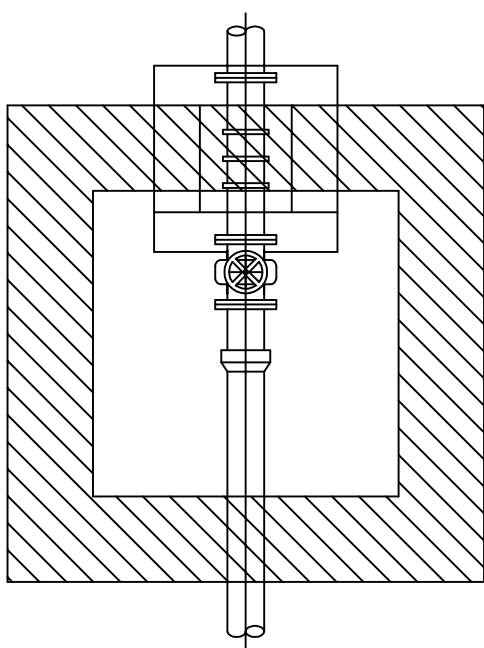


PLANTA-SECCION

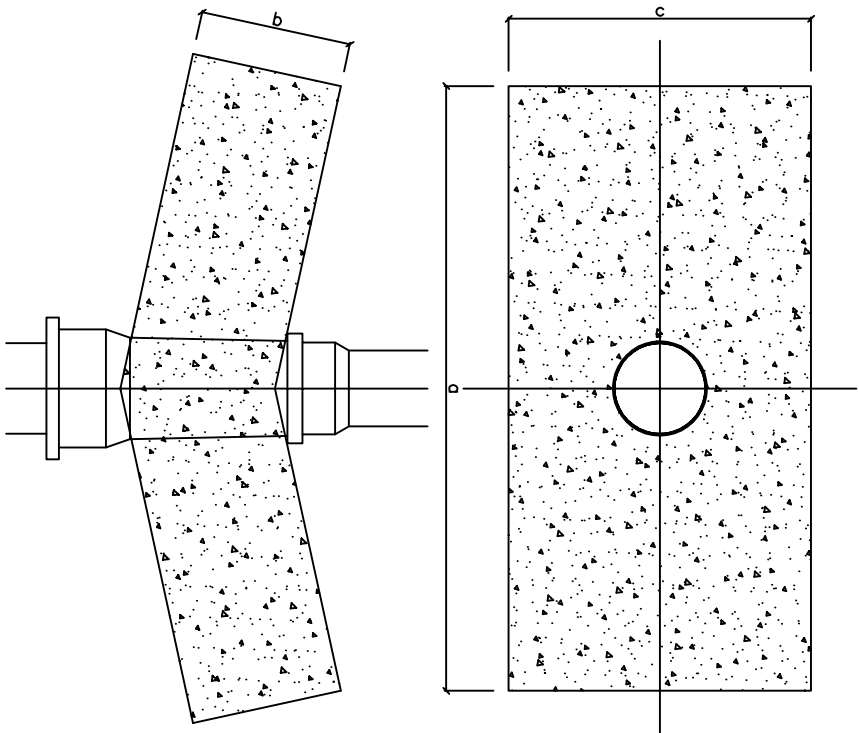


REDUCCION	a	b	c	m.3
250/150	2,25	1,13	0,56	1,42
150/100	1,50	0,75	0,40	0,45
100/80	1,00	0,50	0,30	0,13

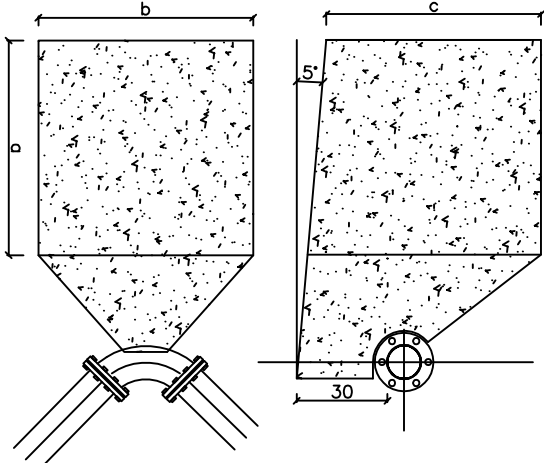

øCÓDIGO	a	a	b	c	m.3
80	90°	0,69	0,69	0,69	0,32
80	45°	0,55	0,55	0,55	0,17
80	22°30'	0,45	0,45	0,45	0,09
100	90°	0,80	0,80	0,80	0,50
100	45°	0,65	0,65	0,65	0,27
100	22°30'	0,52	0,52	0,52	0,14
150	90°	1,04	1,04	1,04	1,13
150	45°	0,85	0,85	0,85	0,61
150	22°30'	0,67	0,67	0,67	0,31

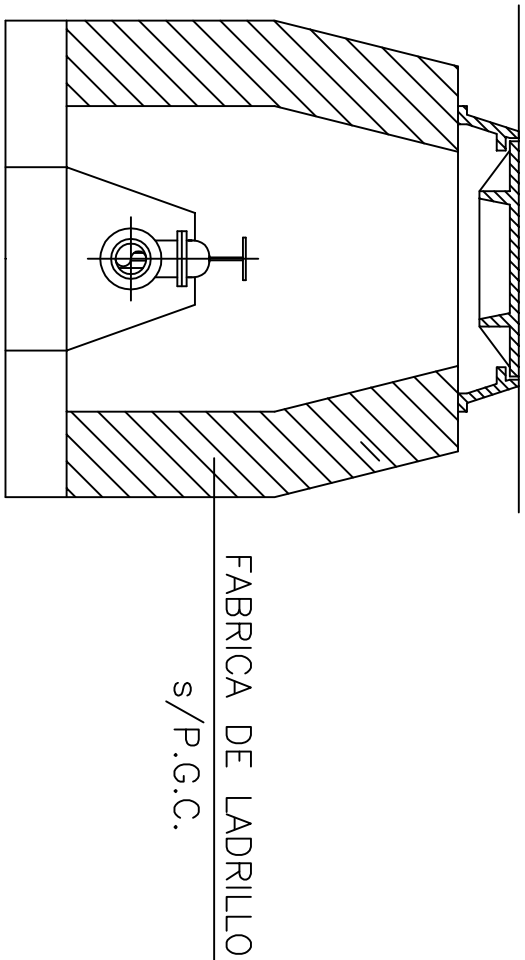


SECCION A.A

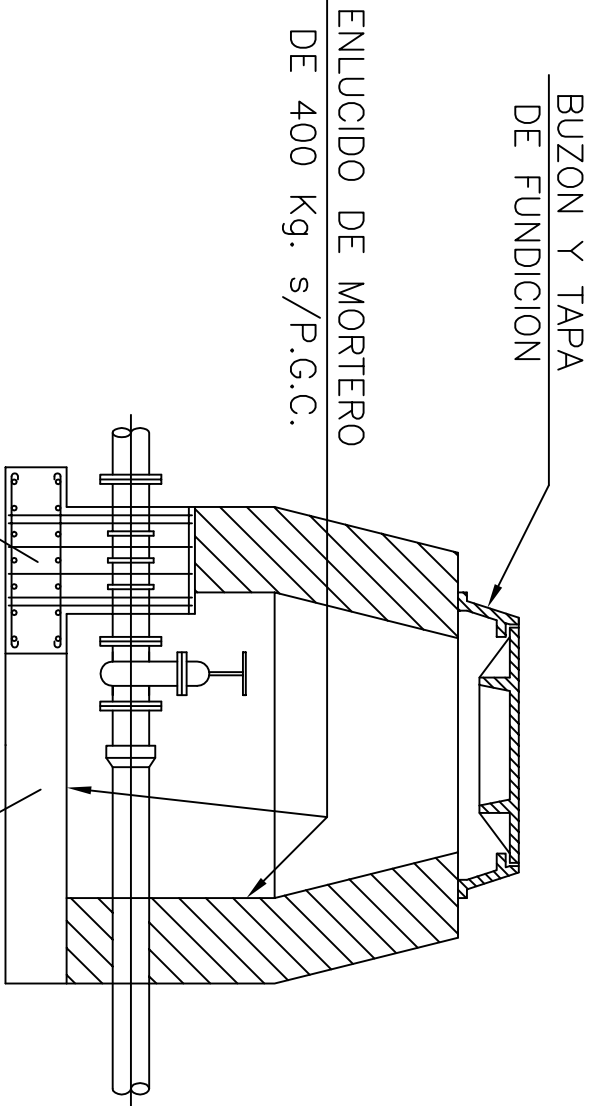

SECCION B.B


SECCION TIPO DE ZANJA
PARA CONDUCCION DE FUNDICION

ESCALA 1/20

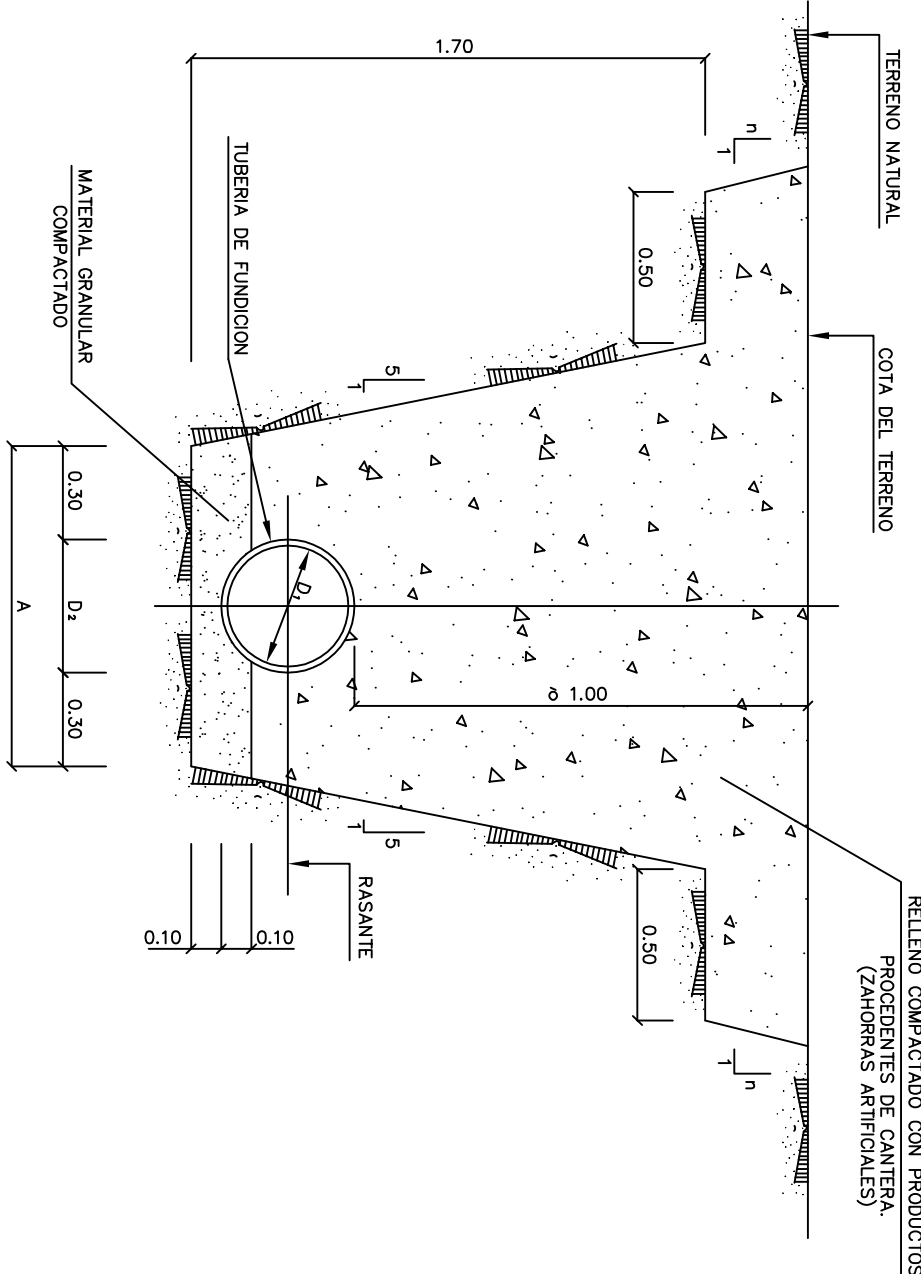


SECCION TIPO DE ZANJA
PARA CONDUCCION DE FIBROCEMENTO

ESCALA 1/20

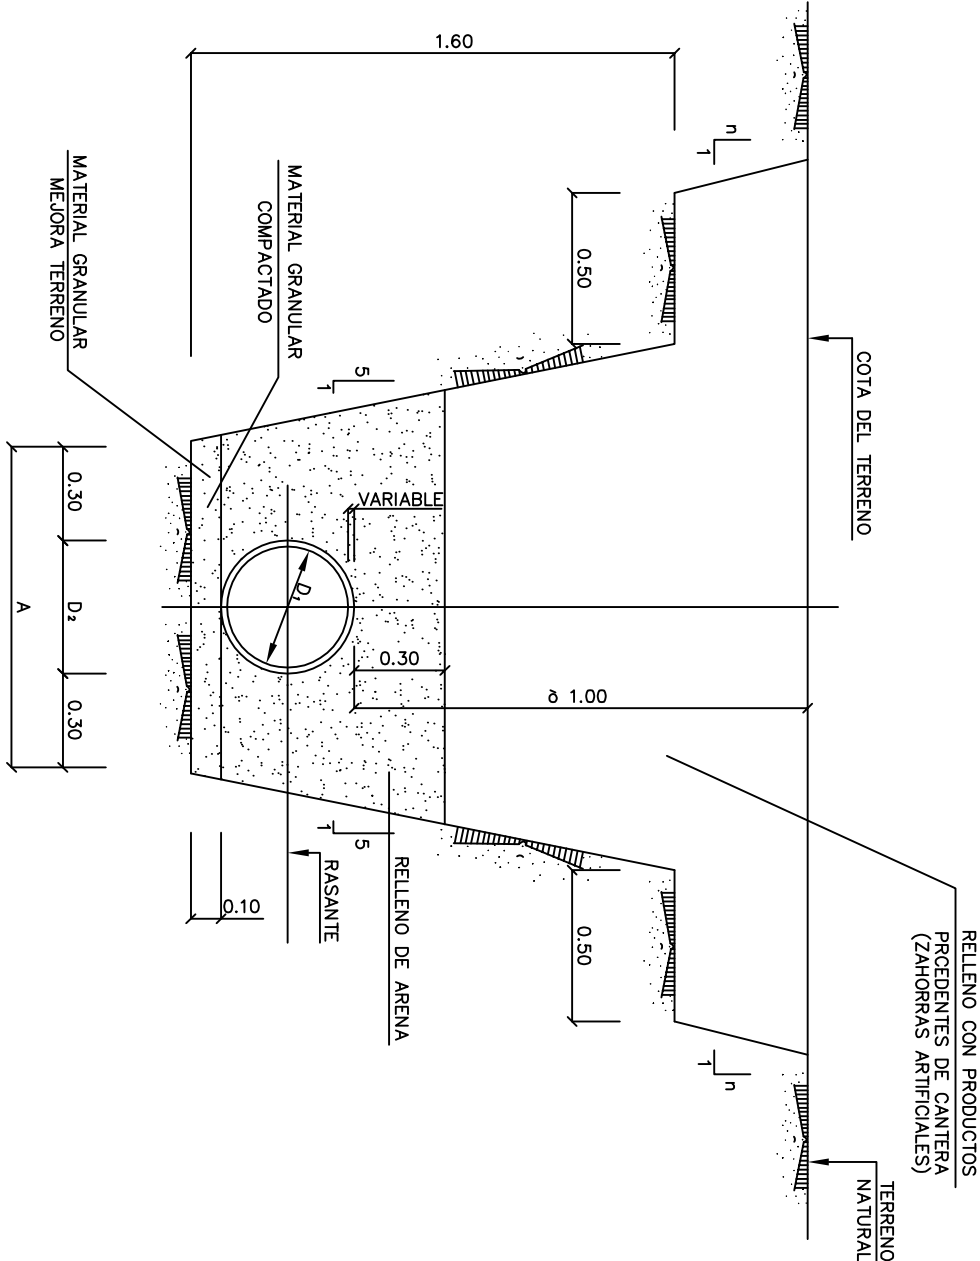

ZANJA TIPO EN PASO
BAJO CAMINOS Y CALLES

ESCALA 1/20

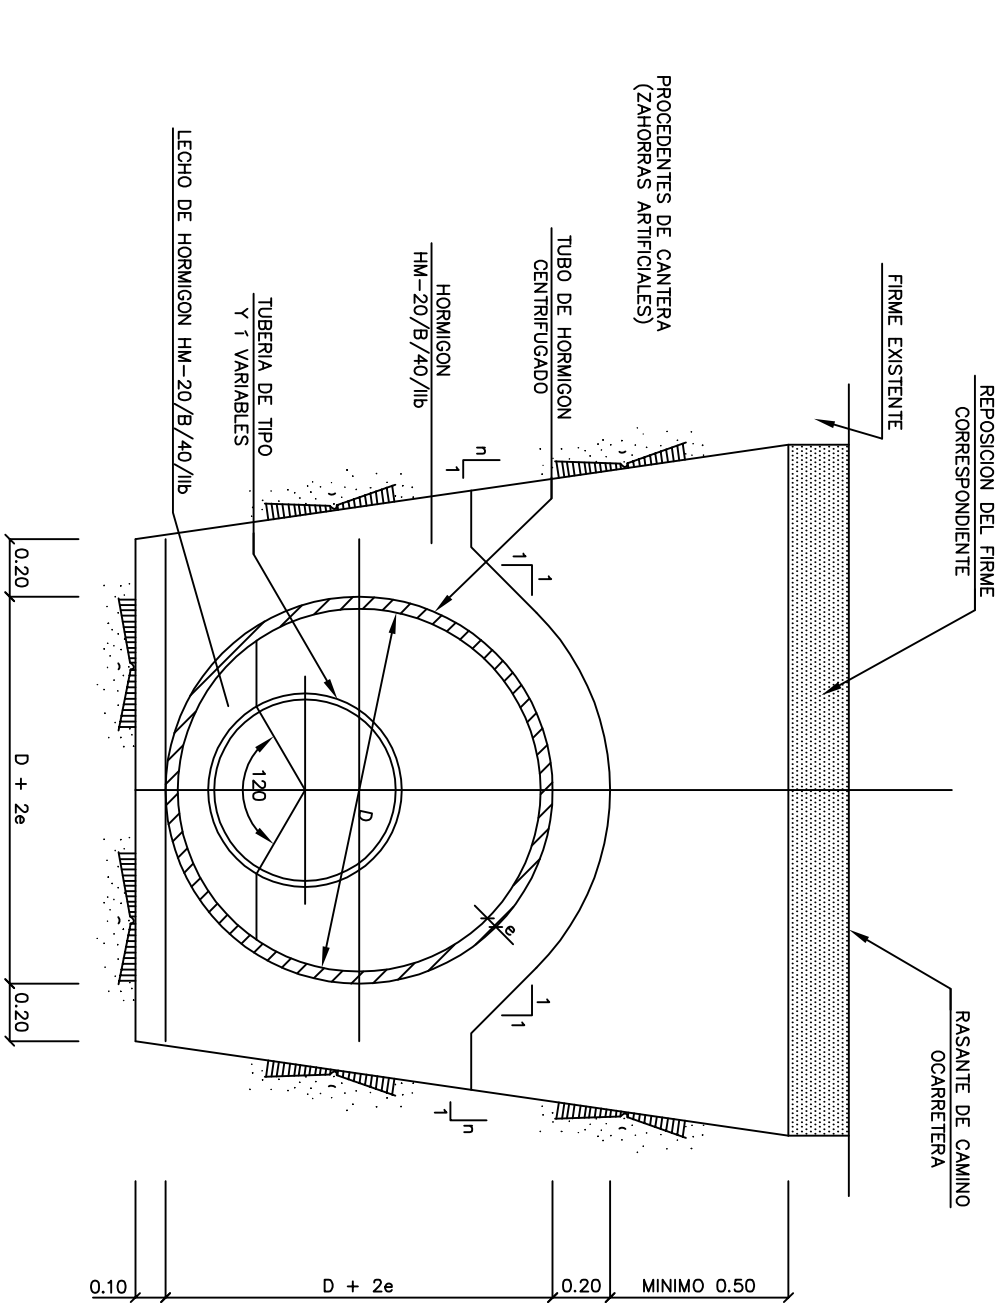

PROYECTO : SUSTITUCION TUBERIA DE IMPULSION EN LA PEDANIA	
MODIFICADO Nº1 DE TORRE DE LLORIS	
PROMOTOR:	Ajuntament de Xàtiva
DETALLES VALVULERIA	
ESCALA: 1/25	
Nº PLANO	

SITUACION: XATIVA (TORRE DE LLORIS)

3.4